

1. COMPACTED COPPER CONDUCTOR
2. CONDUCTOR SEMI-CON
3. XLPE INSULATION
4. INSULATION SEMI-CON
5. COPPER TAPE SCREEN
6. FR PVC BEDDING
7. STEEL WIRE ARMOUR
8. FR PVC OUTER SHEATH

NEELKANTH CABLES LIMITED

DATA SHEET

THREE CORE XLPE ARMoured REDUCED FLAME PROPAGATION (FR) MEDIUM VOLTAGE CABLE

Three Core Cable Description : Copper Conductor, Semi-conducting conductor Screen, XLPE Insulated, Semi-conducting Insulation screen, Metallic screen over Individual Core, FR- PVC Inner Sheathed, Galvanised Steel Wire Armoured, Overall FR-PVC Outer Sheathed, Medium Voltage Cable.

Make	NEELKANTH CABLES LIMITED
Reference Standard	As per IEC 60502-2
Voltage Rating (U _o / U)	6/10 kV
Maximum Operating Voltage (U _m)	12 Kv
Operating Temperature	90°C
Max. Temp. During Short Circuit	250°C

Range of Product Three Core 16 Sq.mm up to 300 Sq.mm

Application

These Medium Voltage Three Core Cables are Designed for Electricity Power Distribution ,Suitable for Installation in Power Supply Stations, Commercial ,Industrial and Urban Residential Networks, Indoors and in Cable Ducts, Outdoors, Undergrounds and as well as for Installation on Cable Trays for industries, Switchboards and the power Stations.

Construction

Conductor Annealed Plain Copper Compacted Round Stranded Conductors to carry Current and withstand Pulling Stresses During Cable Laying. Conductors Complying with IEC 60228 Class-2

Inner Semi-Conducting Screen Extruded Layer of Semi-Conducting Screen over Conductor to Smooth the Electric Field at the Conductor and Firmly Bonded to the Insulation to exclude all air voids ,and Prevent Concentration of electric field of the interface between the Insulation and the Inner Semi-Conductor. Semi-Conducting Compound Complying with IEC 60502-2

Insulation The Insulation of XLPE (Cross-Linked Polyethylene)Rated Voltage, Lightning Overvoltage, Switching Overvoltage, and Withstand the Various Voltage Field Stress During the Cable Service Life. as per SANS IEC 60502-2

Core Semi-Conducting Screen Extruded Layer of Semi-Conducting Screen over the Insulation . The Screen is Tightly Fitted to the Insulation to Exclude all air Voids, Prevent Concentration of electric field of the interface between the Insulation and the Semi-Conductor. Semi-Conducting Compound Complying with IEC 60502-2

Metallic Screen The Metallic Screen Shall Consist of either Copper Tapes or a Concentric layer of Copper Wires .The Metallic Layer may be applied over the Individual Cores .Metallic Screen Provide no Electric Field outer side the Cable, An Active Conductor for the Capacitive and Zero-Sequence short-circuit current, and Contribution to Mechanical Protection. as per IEC 60502-2

Filler (Optional) PVC or Polypropylene yarn

Inner Sheath/Bedding The Inner-sheath Comprises a layer of Extruded as per Requirement PVC Applied Under the Armour, Inner-sheath Compound Complying with IEC 60502-2

Armour The Armour Consists of Round Galvanised Steel Wire for Three Core Cable, Applied over the Inner-sheath. Armour Material Complying with IEC 60502-2

Outer Sheath The Over all Outer-sheath Comprises a layer of Extruded as per Requirement PVC-FR and Applied Over the Armour to Insulate the Mettalic Screen From the Surrounding Medium, to Protect the Mettalic Screen From Corrosion, to Reduce the contribution of cables to Fire Propagation, and Contribute to Mechanical Protection. Outer sheath Compound Complying with IEC 60502-2.
Colour: Black with Red Stripe or as per Requirement

Technical Characteristic

Voltage Grade	6/10 kV
Test Voltage	21 kV for 5 Minute (3.5 U _o r.m.s)
Temperature Rating	-15°C to +90°C
Partial Discharge	IEC 60885-3
Resistivity of Semi-conducting Screen	IEC 60502-2
Flame Retardent	IEC 60332 Part-3-24
Minimum Installation Bending Radius	12(D+d) D= Nominal Diameter of the Cable, d=Nominal Diameter of the Conductor

Marking & Packing

Marking over the sheath	NEELKANTH CABLES , CABLE SIZE, 6/10 kV CU/XLPE/CTS/PVC-FR/SWA/PVC-FR ELECTRIC CABLE , YEAR OF MANUFACTURING
Sequentail Length Marking	Shall be provided on outer sheath at every one Meter
Cable Length	Multiple of 250/500 or as per Requirement
Type of Drum	Wooden Drum Fully Packed with Lagging

Data Sheet No.	10159	Page 1 of 1
Version	01	Issue Date: 29/04/2021



1. COMPACTED COPPER CONDUCTOR
2. CONDUCTOR SEMI-CON
3. XLPE INSULATION
4. INSULATION SEMI-CON
5. COPPER TAPE SCREEN
6. LHFR PVC BEDDING
7. STEEL WIRE ARMOUR
8. LHFR OUTER SHEATH

NEELKANTH CABLES LIMITED

DATA SHEET

THREE CORE XLPE ARMoured, REDUCED HALOGEN EMISSION, REDUCED FLAME PROPAGATION (LHFR) MEDIUM VOLTAGE CABLE

Three Core Cable Description : Copper Conductor,Semi-conducting conductor Screen,XLPE Insulated,Semi-conducting Insulation screen, Metallic screen over Individual Core,LHFR- PVC Inner Sheathed, Galvanised Steel Wire Armoured, Overall LHFR-PVC Outer Sheathed,Medium Voltage Cable.

Make	NEELKANTH CABLES LIMITED
Reference Standard	As per IEC 60502-2
Voltage Rating (U _o / U)	6/10 kV
Maximum Operating Voltage (Um)	12 Kv
Operating Temperature	90°C
Max. Temp. During Short Circuit	250°C

Range of Product Three Core 16 Sq.mm up to 300 Sq.mm

Application

These Medium Voltage Three Core Cables are Designed for Electricity Power Distribution ,Suitable for Installation in Power Supply Stations,Commercial ,Industrial and Urban Residential Networks,Indoors and in Cable Ducts,Outdoors,Undergrounds and as well as for Installation on Cable Trays for industries, Switchboards and the power Stations.

Construction

Conductor	Annealed Plain Copper Compacted Round Stranded Conductors to carry Current and withstand Pulling Stresses During Cable Laying. Conductors Complying with IEC 60228 Class-2
Inner Semi-Conducting Screen	Extruded Layer of Semi-Conducting Screen over Conductor to Smooth the Electric Field at the Conductor and Firmly Bonded to the Insulation to exclude all air voids ,and Prevent Concentration of electric field of the interface between the Insulation and the Inner Semi-Conductor. Semi-Conducting Compound Complying with IEC 60502-2
Insulation	The Insulation of XLPE (Cross-Linked Polyethylene)Rated Voltage, Lightning Overvoltage,Switching Overvoltage, and Withstand the Various Voltage Field Stress During the Cable Service Life.as per SANS IEC 60502-2
Core Semi-Conducting Screen	Extruded Layer of Semi-Conducting Screen over the Insulation . The Screen is Tightly Fitted to the Insulation to Exclude all air Voids,Prevent Concentration of electric field of the interface between the Insulation and the Semi-Conductor. Semi-Conducting Compound Complying with IEC 60502-2
Metallic Screen	The Metallic Screen Shall Consist of either Copper Tapes or a Concentric layer of Copper Wires .The Metallic Layer may be applied over the Individual Cores .Metallic Screen Provide no Electric Field outer side the Cable,An Active Conductor for the Capacitive and Zero-Sequence short-circuit current,and Contribution to Mechanical Protection. as per IEC 60502-2
Filler (Optional)	PVC or Polypropylene yarn
Inner Sheath/Bedding	The Inner-sheath Comprises a layer of Extruded as per Requirement PVC-LHFR Applied Under the Armour,Inner-sheath Compound Complying with SANS 1411-2
Armour	The Armour Consists of Round Galvanised Steel Wire for Three Core Cable, Applied over the Inner-sheath.Armour Material Complying with IEC 60502-2
Outer Sheath	The Over all Outer-sheath Comprises a layer of Extruded as per Requirement PVC-LHFR and Applied Over the Armour to Insulate the Mettalic Screen From the Surrounding Medium,to Protect the Mettalic Screen From Corrosion,to Reduce the contribution of cables to Fire Propagation,and Contribute to Mechanical Protection. Outer sheath Compound Complying with SANS 1411-2. Colour: Black with Blue Stripe or as per Requirement


Technical Characteristic

Voltage Grade	6/10 kV
Test Voltage	21 kV for 5 Minute (3.5 U _o r.m.s)
Temperature Rating	-15°C to +90°C
Partial Discharge	IEC 60885-3
Resistivity of Semi-conducting Screen	IEC 60502-2
Reduced Flame Retardent	IEC 60332 Part-3-24
Reduced Halogen Emission	SANS 5956
Minimum Installation Bending Radius	12(D+d) D= Nominal Diameter of the Cable, d=Nominal Diameter of the Conductor

Marking & Packing

Marking over the sheath	NEELKANTH CABLES , CABLE SIZE, 6/10 kV CU/XLPE/CTS/PVC-LHFR/SWA/PVC-LHFR ELECTRIC CABLE , YEAR OF MANUFACTURING
Sequentail Length Marking	Shall be provided on outer sheath at every one Meter
Cable Length	Multiple of 250/500 or as per Requirement
Type of Drum	Wooden Drum Fully Packed with Lagging

Data Sheet No.	10160	Page 1 of 1
Version	01	Issue Date: 29/04/2021

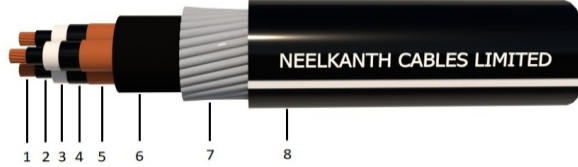

1. COMPACTED COPPER CONDUCTOR
2. CONDUCTOR SEMI-CON
3. XLPE INSULATION
4. INSULATION SEMI-CON
5. COPPER TAPE SCREEN
6. NHLSFR BEDDING
7. STEEL WIRE ARMOUR
8. NHLSFR OUTER SHEATH

**NEELKANTH CABLES LIMITED
DATA SHEET**

THREE CORE XLPE ARMURED, ZERO HALOGEN EMISSION, REDUCED SMOKE EMISSION, REDUCED FLAME PROPAGATION (NHLSFR) MEDIUM VOLTAGE CABLE

Three Core Cable Description : Copper Conductor, Semi-conducting conductor Screen, XLPE Insulated, Semi-conducting Insulation screen, Metallic screen over Individual Core, NHLSFR (Polyolefin) Inner Sheathed, Galvanised Steel Wire Armoured, Overall NHLSFR (Polyolefin) Outer Sheathed, Medium Voltage Cable.

Make	NEELKANTH CABLES LIMITED
Reference Standard	As per IEC 60502-2
Voltage Rating (U _o / U)	6/10 kV
Maximum Operating Voltage (U _m)	12 Kv
Operating Temperature	90°C
Max. Temp. During Short Circuit	250°C

Range of Product Three Core 16 Sq.mm up to 300 Sq.mm

Application

These Medium Voltage Three Core Cables are Designed for Electricity Power Distribution, Suitable for Installation in Power Supply Stations, Commercial, Industrial and Urban Residential Networks, Indoors and in Cable Ducts, Outdoors, Undergrounds and as well as for Installation on Cable Trays for industries, Switchboards and the power Stations.

Construction


Conductor	Annealed Plain Copper Compacted Round Stranded Conductors to carry Current and withstand Pulling Stresses During Cable Laying. Conductors Complying with IEC 60228 Class-2
Inner Semi-Conducting Screen	Extruded Layer of Semi-Conducting Screen over Conductor to Smooth the Electric Field at the Conductor and Firmly Bonded to the Insulation to exclude all air voids, and Prevent Concentration of electric field of the interface between the Insulation and the Inner Semi-Conductor. Semi-Conducting Compound Complying with IEC 60502-2
Insulation	The Insulation of XLPE (Cross-Linked Polyethylene) Rated Voltage, Lightning Overvoltage, Switching Overvoltage, and Withstand the Various Voltage Field Stress During the Cable Service Life. as per SANS IEC 60502-2
Core Semi-Conducting Screen	Extruded Layer of Semi-Conducting Screen over the Insulation. The Screen is Tightly Fitted to the Insulation to Exclude all air Voids, Prevent Concentration of electric field of the interface between the Insulation and the Semi-Conductor. Semi-Conducting Compound Complying with IEC 60502-2
Metallic Screen	The Metallic Screen Shall Consist of either Copper Tapes or a Concentric layer of Copper Wires. The Metallic Layer may be applied over the Individual Cores. Metallic Screen Provide no Electric Field outer side the Cable, An Active Conductor for the Capacitive and Zero-Sequence short-circuit current, and Contribution to Mechanical Protection. as per IEC 60502-2
Filler (Optional)	PVC or Polypropylene yarn
Inner Sheath/Bedding	The Inner-sheath Comprises a layer of Extruded as per Requirement NHLSFR (Polyolefin) Applied Under the Armour, Inner-sheath Compound Complying with SANS 1411-5
Armour	The Armour Consists of Round Galvanised Steel Wire for Three Core Cable, Applied over the Inner-sheath. Armour Material Complying with IEC 60502-2
Outer Sheath	The Over all Outer-sheath Comprises a layer of Extruded as per Requirement NHLSFR (Polyolefin) and Applied Over the Armour to Insulate the Metallic Screen From the Surrounding Medium, to Protect the Metallic Screen From Corrosion, to Reduce the contribution of cables to Fire Propagation, and Contribute to Mechanical Protection. Outer sheath Compound Complying with SANS 1411-5. Colour: Black with White Stripe or as per Requirement

Technical Characteristic

Voltage Grade	6/10 kV
Test Voltage	21 kV for 5 Minute (3.5 U _o r.m.s)
Temperature Rating	-15°C to +90°C
Partial Discharge	IEC 60885-3
Resistivity of Semi-conducting Screen	IEC 60502-2
Reduced Flame Retardent	IEC 60332 Part-3-24
Zero Halogen Emission	SANS 60754-2
Minimum Installation Bending Radius	12(D+d) D= Nominal Diameter of the Cable, d=Nominal Diameter of the Conductor

Marking & Packing

Marking over the sheath	NEELKANTH CABLES , CABLE SIZE, 6/10 kV CU/XLPE/CTS/NHLSFR/SWA/NHLSFR ELECTRIC CABLE , YEAR OF MANUFACTURING
Sequentail Length Marking	Shall be provided on outer sheath at every one Meter
Cable Length	Multiple of 250/500 or as per Requirement
Type of Drum	Wooden Drum Fully Packed with Lagging

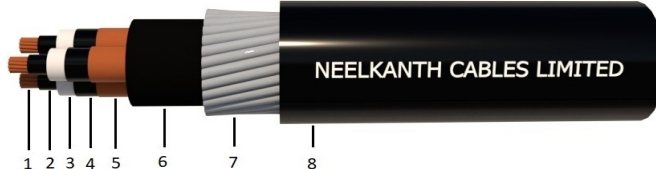

1. COMPACTED COPPER CONDUCTOR
2. CONDUCTOR SEMI-CON
3. XLPE INSULATION
4. INSULATION SEMI-CON
5. COPPER TAPE SCREEN
6. FR PVC BEDDING
7. STEEL WIRE ARMOUR
8. PE OUTER SHEATH

**NEELKANTH CABLES LIMITED
DATA SHEET**

THREE CORE XLPE ARMoured, UV STABILIZED POLYETHYLENE OUTER SHEATHED (PE) MEDIUM VOLTAGE CABLE

Three Core Cable Description : Copper Conductor, Semi-conducting conductor Screen, XLPE Insulated, Semi-conducting Insulation screen, Metallic screen over Individual Core, PVC-FR Inner Sheathed, Galvanised Steel Wire Armoured, Overall UV Stabilized Polyethylene (PE) Outer Sheathed, Medium Voltage Cable.

Make	NEELKANTH CABLES LIMITED
Reference Standard	As per IEC 60502-2
Voltage Rating (U _o / U)	6/10 kV
Maximum Operating Voltage (U _m)	12 Kv
Operating Temperature	90°C
Max. Temp. During Short Circuit	250°C

Range of Product Three Core 16 Sq.mm up to 300 Sq.mm

Application

These Medium Voltage Three Cores Cables are Designed for Electricity Power Distribution , Suitable for Installation in Power Supply Stations, Commercial , Industrial and Urban Residential Networks, Indoors and in Cable Ducts, Outdoors, Undergrounds and as well as for Installation on Cable Trays for industries, Switchboards and the power Stations.

Construction

Conductor	Annealed Plain Copper Compacted Round Stranded Conductors to carry Current and withstand Pulling Stresses During Cable Laying. Conductors Complying with IEC 60228 Class-2
Inner Semi-Conducting Screen	Extruded Layer of Semi-Conducting Screen over Conductor to Smooth the Electric Field at the Conductor and Firmly Bonded to the Insulation to exclude all air voids ,and Prevent Concentration of electric field of the interface between the Insulation and the Inner Semi-Conductor. Semi-Conducting Compound Complying with IEC 60502-2
Insulation	The Insulation of XLPE (Cross-Linked Polyethylene) Rated Voltage, Lightning Overoltage, Switching Overvoltage, and Withstand the Various Voltage Field Stress During the Cable Service Life. as per SANS IEC 60502-2
Core Semi-Conducting Screen	Extruded Layer of Semi-Conducting Screen over the Insulation . The Screen is Tightly Fitted to the Insulation to Exclude all air Voids, Prevent Concentration of electric field of the interface between the Insulation and the Semi-Conductor. Semi-Conducting Compound Complying with IEC 60502-2
Metallic Screen	The Metallic Screen Shall Consist of either Copper Tapes or a Concentric layer of Copper Wires .The Metallic Layer may be applied over the Individual Cores .Metallic Screen Provide no Electric Field outer side the Cable, An Active Conductor for the Capacitive and Zero-Sequence short-circuit current, and Contribution to Mechanical Protection. as per IEC 60502-2
Filler (Optional)	PVC or Polypropylene yarn
Inner Sheath/Bedding	The Inner-sheath Comprises a layer of Extruded as per Requirement PVC-FR, Applied Under the Armour, Inner-sheath Compound Complying with SANS 1411-2
Armour	The Armour Consists of Round Galvanised Steel Wire for Three Core Cable, Applied over the Inner-sheath. Armour Material Complying with SANS 1411-6
Outer Sheath	The Over all Outer-sheath Comprises a layer of Extruded as per Requirement Polyethylene (PE) and Applied Over the Armour to Insulate the Metallac Screen From the Surrounding Medium, to Protect the Metallac Screen From Corrosion, to Reduce the contribution of cables to Fire Propagation, and Contribute to Mechanical Protection. Outer sheath Compound Complying with SANS 1411-7. Colour: Black or as per Requirement

Technical Characteristic

Voltage Grade	6/10 kV
Test Voltage	21 kV for 5 Minute (3.5 U _o r.m.s)
Temperature Rating	-15°C to +90°C
Partial Discharge	IEC 60885-3
Resistivity of Semi-conducting Screen	IEC 60502-2
Minimum Installation Bending Radius	12(D+d) D= Nominal Diameter of the Cable, d=Nominal Diameter of the Conductor

Marking & Packing

Marking over the sheath	NEELKANTH CABLES , CABLE SIZE, 6/10 kV CU/XLPE/CTS/PVC-FR/SWA/PE, ELECTRIC CABLE , YEAR OF MANUFACTURING
Sequentail Length Marking	Shall be provided on outer sheath at every one Meter
Cable Length	Multiple of 250/500 or as per Requirement
Type of Drum	Wooden Drum Fully Packed with Lagging

Data Sheet No.	10162	Page 1 of 1
Version	01	Issue Date: 29/04/2021



1. COMPACTED COPPER CONDUCTOR
2. CONDUCTOR SEMI-CON
3. XLPE INSULATION
4. INSULATION SEMI-CON
5. COPPER TAPE SCREEN
6. FR PVC BEDDING
7. FR PVC OUTER SHEATH

NEELKANTH CABLES LIMITED

DATA SHEET

THREE CORE XLPE UNARMOURED REDUCED FLAME PROPAGATION (FR) MEDIUM VOLTAGE CABLE

Three Core Cable Description : Copper Conductor, Semi-conducting conductor Screen, XLPE Insulated, Semi-conducting Insulation screen, Metallic screen over Individual Core, FR- PVC Inner Sheathed, Overall FR-PVC Outer Sheathed, Medium Voltage Unarmoured Cable.

Make	NEELKANTH CABLES LIMITED
Reference Standard	As per IEC 60502-2
Voltage Rating (U _o / U)	6/10 kV
Maximum Operating Voltage (U _m)	12 kV
Operating Temperature	90°C
Max. Temp. During Short Circuit	250°C

Range of Product Three Core 16 Sq.mm up to 300 Sq.mm

Application

These Medium Voltage Three Core Cables are Designed for Electricity Power Distribution ,Suitable for Installation in Power Supply Stations, Commercial ,Industrial and Urban Residential Networks, Indoors and in Cable Ducts, Outdoors, Undergrounds and as well as for Installation on Cable Trays for industries, Switchboards and the power Stations.

Construction

Conductor	Annealed Plain Copper Compacted Round Stranded Conductors to carry Current and withstand Pulling Stresses During Cable Laying. Conductors Complying with IEC 60228 Class-2
Inner Semi-Conducting Screen	Extruded Layer of Semi-Conducting Screen over Conductor to Smooth the Electric Field at the Conductor and Firmly Bonded to the Insulation to exclude all air voids ,and Prevent Concentration of electric field of the interface between the Insulation and the Inner Semi-Conductor. Semi-Conducting Compound Complying with IEC 60502-2
Insulation	The Insulation of XLPE (Cross-Linked Polyethylene)Rated Voltage, Lightning Overvoltage, Switching Overvoltage, and Withstand the Various Voltage Field Stress During the Cable Service Life.as per SANS IEC 60502-2
Core Semi-Conducting Screen	Extruded Layer of Semi-Conducting Screen over the Insulation . The Screen is Tightly Fitted to the Insulation to Exclude all air Voids, Prevent Concentration of electric field of the interface between the Insulation and the Semi-Conductor. Semi-Conducting Compound Complying with IEC 60502-2
Metallic Screen	The Metallic Screen Shall Consist of either Copper Tapes or a Concentric layer of Copper Wires .The Metallic Layer may be applied over the Individual Cores .Metallic Screen Provide no Electric Field outer side the Cable, An Active Conductor for the Capacitive and Zero-Sequence short-circuit current, and Contribution to Mechanical Protection. as per IEC 60502-2
Filler (Optional)	PVC or Polypropylene yarn
Inner Sheath/Bedding	The Inner-sheath Comprises a layer of Extruded as per Requirement PVC Applied Under the Armour, Inner-sheath Compound Complying with IEC 60502-2
Outer Sheath	The Over all Outer-sheath Comprises a layer of Extruded as per Requirement PVC-FR and Applied Over the Armour to Insulate the Metallic Screen From the Surrounding Medium, to Protect the Metallic Screen From Corrosion, to Reduce the contribution of cables to Fire Propagation, and Contribute to Mechanical Protection. Outer sheath Compound Complying with IEC 60502-2. Colour: Black with Red Stripe or as per Requirement

Technical Characteristic

Voltage Grade	6/10 kV
Test Voltage	21 kV for 5 Minute (3.5 U _o r. m. s)
Temperature Rating	-15°C to +90°C
Partial Discharge	IEC 60885-3
Resistivity of Semi-conducting Screen	IEC 60502-2
Flame Retardent	IEC 60332 Part-3-24
Minimum Installation Bending Radius	15(D+d) D= Nominal Diameter of the Cable, d=Nominal Diameter of the Conductor

Marking & Packing

Marking over the sheath	NEELKANTH CABLES , CABLE SIZE, 6/10 kV CU/XLPE/CTS/PVC-FR/PVC-FR ELECTRIC CABLE , YEAR OF MANUFACTURING
Sequentail Length Marking	Shall be provided on outer sheath at every one Meter
Cable Length	Multiple of 250/500 or as per Requirement
Type of Drum	Wooden Drum Fully Packed with Lagging

Data Sheet No.	10163	Page 1 of 1
Version	01	Issue Date: 29/04/2021



1. COMPACTED COPPER CONDUCTOR
2. CONDUCTOR SEMI-CON
3. XLPE INSULATION
4. INSULATION SEMI-CON
5. COPPER TAPE SCREEN
6. LHFR BEDDING
7. LHFR OUTER SHEATH

**NEELKANTH CABLES LIMITED
DATA SHEET**

THREE CORE XLPE UNARMoured, REDUCED HALOGEN EMISSION, REDUCED FLAME PROPAGATION (LHFR) MEDIUM VOLTAGE CABLE

Three Core Cable Description : Copper Conductor,Semi-conducting conductor Screen,XLPE Insulated,Semi-conducting Insulation screen, Metallic screen over Individual Core,LHFR- PVC Inner Sheathed, Overall LHFR-PVC Outer Sheathed,Medium Voltage Unarmoured Cable.

Make	NEELKANTH CABLES LIMITED
Reference Standard	As per IEC 60502-2
Voltage Rating (U _o / U)	6/10 kV
Maximum Operating Voltage (U _m)	12 Kv
Operating Temperature	90°C
Max. Temp. During Short Circuit	250°C

Range of Product Three Core 16 Sq.mm up to 300 Sq.mm

Application

These Medium Voltage Three Core Cables are Designed for Electricity Power Distribution ,Suitable for Installation in Power Supply Stations,Commercial ,Industrial and Urban Residential Networks,Indoors and in Cable Ducts,Outdoors,Undergrounds and as well as for Installation on Cable Trays for industries, Switchboards and the power Stations.

Construction

Conductor	Annealed Plain Copper Compacted Round Stranded Conductors to carry Current and withstand Pulling Stresses During Cable Laying. Conductors Complying with IEC 60228 Class-2
Inner Semi-Conducting Screen	Extruded Layer of Semi-Conducting Screen over Conductor to Smooth the Electric Field at the Conductor and Firmly Bonded to the Insulation to exclude all air voids ,and Prevent Concentration of electric field of the interface between the Insulation and the Inner Semi-Conductor. Semi-Conducting Compound Complying with IEC 60502-2
Insulation	The Insulation of XLPE (Cross-Linked Polyethylene)Rated Voltage, Lightning Overvoltage,Switching Overvoltage, and Withstand the Various Voltage Field Stress During the Cable Service Life.as per SANS IEC 60502-2
Core Semi-Conducting Screen	Extruded Layer of Semi-Conducting Screen over the Insulation . The Screen is Tightly Fitted to the Insulation to Exclude all air Voids,Prevent Concentration of electric field of the interface between the Insulation and the Semi-Conductor. Semi-Conducting Compound Complying with IEC 60502-2
Metallic Screen	The Metallic Screen Shall Consist of either Copper Tapes or a Concentric layer of Copper Wires .The Metallic Layer may be applied over the Individual Cores .Metallic Screen Provide no Electric Field outer side the Cable,An Active Conductor for the Capacitive and Zero-Sequence short-circuit current,and Contribution to Mechanical Protection. as per IEC 60502-2
Filler (Optional)	PVC or Polypropylene yarn
Inner Sheath/Bedding	The Inner-sheath Comprises a layer of Extruded as per Requirement PVC-LHFR Applied Under the Armour,Inner-sheath Compound Complying with SANS 1411-2
Outer Sheath	The Over all Outer-sheath Comprises a layer of Extruded as per Requirement PVC-LHFR and Applied Over the Armour to Insulate the Mettalic Screen From the Surrounding Medium,to Protect the Mettalic Screen From Corrosion,to Reduce the contribution of cables to Fire Propagation,and Contribute to Mechanical Protection. Outer sheath Compound Complying with SANS 1411-2. Colour: Black with Blue Stripe or as per Requirement


Technical Characteristic

Voltage Grade	6/10 kV
Test Voltage	21 kV for 5 Minute (3.5 U _o r.m.s)
Temperature Rating	-15°C to +90°C
Partial Discharge	IEC 60885-3
Resistivity of Semi-conducting Screen	IEC 60502-2
Reduced Flame Retardent	IEC 60332 Part-3-24
Reduced Halogen Emission	SANS 5956
Minimum Installation Bending Radius	15(D+d) D= Nominal Diameter of the Cable, d=Nominal Diameter of the Conductor

Marking & Packing

Marking over the sheath	NEELKANTH CABLES , CABLE SIZE, 6/10 kV CU/XLPE/CTS/PVC-LHFR/PVC-LHFR ELECTRIC CABLE , YEAR OF MANUFACTURING
Sequentail Length Marking	Shall be provided on outer sheath at every one Meter
Cable Length	Multiple of 250/500 or as per Requirement
Type of Drum	Wooden Drum Fully Packed with Lagging

Data Sheet No.	10164	Page 1 of 1
Version	01	Issue Date: 29/04/2021

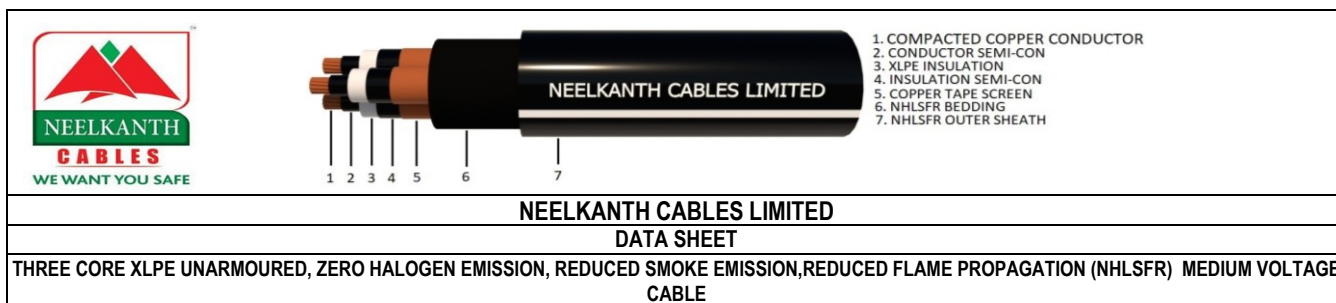

NEELKANTH CABLES LIMITED

DATA SHEET

THREE CORE XLPE UNARMOURED, ZERO HALOGEN EMISSION, REDUCED SMOKE EMISSION, REDUCED FLAME PROPAGATION (NHLSFR) MEDIUM VOLTAGE CABLE

Three Core Cable Description : Copper Conductor, Semi-conducting conductor Screen, XLPE Insulated, Semi-conducting Insulation screen, Metallic screen over Individual Core, NHLSFR Inner Sheath, Overall NHLSFR (Polyolefin) Outer Sheathed, Medium Voltage Unarmoured Cable.

Make	NEELKANTH CABLES LIMITED
Reference Standard	As per IEC 60502-2
Voltage Rating (U ₀ / U)	6/10 kV
Maximum Operating Voltage (U _m)	12 Kv
Operating Temperature	90°C
Max. Temp. During Short Circuit	250°C

Range of Product Three Core 16 Sq.mm up to 300 Sq.mm

Application

These Medium Voltage Three Core Cables are Designed for Electricity Power Distribution, Suitable for Installation in Power Supply Stations, Commercial, Industrial and Urban Residential Networks, Indoors and in Cable Ducts, Outdoors, Undergrounds and as well as for Installation on Cable Trays for industries, Switchboards and the power Stations.

Construction

Conductor	Annealed Plain Copper Compacted Round Stranded Conductors to carry Current and withstand Pulling Stresses During Cable Laying. Conductors Complying with IEC 60228 Class-2
Inner Semi-Conducting Screen	Extruded Layer of Semi-Conducting Screen over Conductor to Smooth the Electric Field at the Conductor and Firmly Bonded to the Insulation to exclude all air voids, and Prevent Concentration of electric field of the interface between the Insulation and the Inner Semi-Conductor. Semi-Conducting Compound Complying with IEC 60502-2
Insulation	The Insulation of XLPE (Cross-Linked Polyethylene) Rated Voltage, Lightning Overvoltage, Switching Overvoltage, and Withstand the Various Voltage Field Stress During the Cable Service Life, as per SANS IEC 60502-2
Core Semi-Conducting Screen	Extruded Layer of Semi-Conducting Screen over the Insulation. The Screen is Tightly Fitted to the Insulation to Exclude all air Voids, Prevent Concentration of electric field of the interface between the Insulation and the Semi-Conductor. Semi-Conducting Compound Complying with IEC 60502-2
Metallic Screen	The Metallic Screen Shall Consist of either Copper Tapes or a Concentric layer of Copper Wires. The Metallic Layer may be applied over the Individual Cores. Metallic Screen Provide no Electric Field outer side the Cable, An Active Conductor for the Capacitive and Zero-Sequence short-circuit current, and Contribution to Mechanical Protection. as per IEC 60502-2
Filler (Optional)	PVC or Polypropylene yarn
Inner Sheath/Bedding	The Inner-sheath Comprises a layer of Extruded as per Requirement NHLSFR (Polyolefin) Applied Under the Armour, Inner-sheath Compound Complying with SANS 1411-5
Outer Sheath	The Over all Outer-sheath Comprises a layer of Extruded as per Requirement NHLSFR (Polyolefin) and Applied Over the Armour to Insulate the Metallic Screen From the Surrounding Medium, to Protect the Metallic Screen From Corrosion, to Reduce the contribution of cables to Fire Propagation, and Contribute to Mechanical Protection. Outer sheath Compound Complying with SANS 1411-5. Colour: Black with White Stripe or as per Requirement

Technical Characteristic

Voltage Grade	6/10 kV
Test Voltage	21 kV for 5 Minute (3.5 U ₀ r.m.s)
Temperature Rating	-15°C to +90°C
Partial Discharge	IEC 60885-3
Resistivity of Semi-conducting Screen	IEC 60502-2
Reduced Flame Retardent	IEC 60332 Part-3-24
Zero Halogen Emission	SANS 60754-2
Minimum Installation Bending Radius	15(D+d) D= Nominal Diameter of the Cable, d=Nominal Diameter of the Conductor

Marking & Packing

Marking over the sheath	NEELKANTH CABLES, CABLE SIZE, 6/10 kV CU/XLPE/CTS/NHLSFR/NHLSFR ELECTRIC CABLE, YEAR OF MANUFACTURING
Sequentail Length Marking	Shall be provided on outer sheath at every one Meter
Cable Length	Multiple of 250/500 or as per Requirement
Type of Drum	Wooden Drum Fully Packed with Lagging



1. COMPACTED COPPER CONDUCTOR
2. CONDUCTOR SEMI-CON
3. XLPE INSULATION
4. INSULATION SEMI-CON
5. COPPER TAPE SCREEN
6. FR PVC BEDDING
7. PE OUTER SHEATH

NEELKANTH CABLES LIMITED

DATA SHEET

THREE CORE XLPE UNARMOURED, UV STABILIZED POLYETHYLENE OUTER SHEATHED (PE) MEDIUM VOLTAGE CABLE

Three Core Cable Description : Copper Conductor, Semi-conducting conductor Screen, XLPE Insulated, Semi-conducting Insulation screen, Metallic screen over Individual Core, PVC-FR Inner Sheathed, Overall UV Stabilized Polyethylene (PE) Outer Sheathed, Medium Voltage Unarmoured Cable.

Make	NEELKANTH CABLES LIMITED
Reference Standard	As per IEC 60502-2
Voltage Rating (U _o / U)	6/10 kV
Maximum Operating Voltage (U _m)	12 Kv
Operating Temperature	90°C
Max. Temp. During Short Circuit	250°C

Range of Product Three Core 16 Sq.mm up to 300 Sq.mm

Application

These Medium Voltage Three Core Cores Cables are Designed for Electricity Power Distribution ,Suitable for Installation in Power Supply Stations, Commercial ,Industrial and Urban Residential Networks, Indoors and in Cable Ducts, Outdoors, Undergrounds and as well as for Installation on Cable Trays for industries, Switchboards and the power Stations.

Construction

Conductor	Annealed Plain Copper Compacted Round Stranded Conductors to carry Current and withstand Pulling Stresses During Cable Laying. Conductors Complying with IEC 60228 Class-2
Inner Semi-Conducting Screen	Extruded Layer of Semi-Conducting Screen over Conductor to Smooth the Electric Field at the Conductor and Firmly Bonded to the Insulation to exclude all air voids ,and Prevent Concentration of electric field of the interface between the Insulation and the Inner Semi-Conductor. Semi-Conducting Compound Complying with IEC 60502-2
Insulation	The Insulation of XLPE (Cross-Linked Polyethylene)Rated Voltage, Lightning Overvoltage, Switching Overvoltage, and Withstand the Various Voltage Field Stress During the Cable Service Life.as per SANS IEC 60502-2
Core Semi-Conducting Screen	Extruded Layer of Semi-Conducting Screen over the Insulation . The Screen is Tightly Fitted to the Insulation to Exclude all air Voids, Prevent Concentration of electric field of the interface between the Insulation and the Semi-Conductor. Semi-Conducting Compound Complying with IEC 60502-2
Metallic Screen	The Metallic Screen Shall Consist of either Copper Tapes or a Concentric layer of Copper Wires .The Metallic Layer may be applied over the Individual Cores .Metallic Screen Provide no Electric Field outer side the Cable, An Active Conductor for the Capacitive and Zero-Sequence short-circuit current, and Contribution to Mechanical Protection. as per IEC 60502-2
Filler (Optional)	PVC or Polypropylene yarn
Inner Sheath/Bedding	The Inner-sheath Comprises a layer of Extruded as per Requirement PVC-FR Applied Under the Armour, Inner-sheath Compound Complying with iec 60502-2
Outer Sheath	The Over all Outer-sheath Comprises a layer of Extruded as per Requirement Polyethylene (PE) and Applied Over the Armour to Insulate the Mettalic Screen From the Surrounding Medium, to Protact the Mettalic Screen From Corrosion, to Reduce the contribution of cables to Fire Propagation, and Contribute to Mechanical Protection. Outer sheath Compound Complying with SANS 1411-7. Colour: Black or as per Requirement

Technical Characteristic

Voltage Grade	6/10 kV
Test Voltage	21 kV for 5 Minute (3.5 U _o r.m.s)
Temperature Rating	-15°C to +90°C
Partial Discharge	IEC 60885-3
Resistivity of Semi-conducting Screen	IEC 60502-2
Minimum Installation Bending Radius	15(D+d) D= Nominal Diameter of the Cable, d=Nominal Diameter of the Conductor

Marking & Packing

Marking over the sheath	NEELKANTH CABLES , CABLE SIZE, 6/10 kV CU/XLPE/CTS/PVC-FR/PE, ELECTRIC CABLE , YEAR OF MANUFACTURING
Sequentail Length Marking	Shall be provided on outer sheath at every one Meter
Cable Length	Multiple of 250/500 or as per Requirement
Type of Drum	Wooden Drum Fully Packed with Lagging

Data Sheet No.	10166	Page 1 of 1
Version	01	Issue Date: 29/04/2021